POWER YOUR FUTURE

Cummins Generator LG460C

KTAA19-G6

Prime Power: 460KW/575KVA

Standby Power: 510KW/633KVA



GENERATING POWER SOLUTIONS

Increased availability for new operations

Reliable, robust and versatile generator. Ready to deliver power for a next job.

Increased uptime during operations

Once installed on the end-user-site, the generator will be ready to run: "peace of mind" operation.

Reduced transport and installation costs

The compact and robust design with integrated transport features enables faster and safer transport and installation.

Reduced service & maintenance costs

Longer service intervals.

Quicker and more efficient service jobs.

Premium resale value

Designed and built to last.



- Operate safely in accordance with proper operation manual.
- To prevent trouble and accidents perform daily and preventive maintenance checks without fail.

Cummins Series

25KVA--2000KVA



FUAN LONGKAI POWER CO.,LTD.

Headquarters:

Add: Wei 5 Road, Tiehu Industrial Zone, Fuan, Fujian, China

Tel:+86-0593-6309773 Fax:+86-0593-6586988

E-mail: sales@longkaipower.com Web: www.longkaipower.com



Technical Data

Model **LG460C** Rated prime power 575 kva Rated standard power 633 kva Rated voltage line to line ٧ 400/230 Rated current Α 830 Maximun sound level dB(@7m) ≤100

Engine-DCEC Cummins		
Model		KTAA19-G6
Aspiration	Four-stro	ke, in-line, six-cylinder
Fuel system		PT(G)-EFC
No. cylinders		6 in line
Displacement	Liquid	19
Bore*Stroke	mm	159*159
Compression ratio		13.9:1
Rated speed	r/min	1500
Rated net power(with fan)	Kw	570
Governor type		EFC Electrical
Start Motor	V	24

Exhause System		
Exhause gas flow	L/s	1860
Exhause gas temp	$^{\circ}\!\mathrm{C}$	433
Max back pressure	kPa	10

Aspiration System		
Max inlet pressure	kPa	100
Combustion volume	L/s	6.23
Air flow	L/s	623

Fuel System		
100% load(Prime power)	Kg/h	112
75% load(Prime power)	Kg/h	83
50% load(Prime power)	Kg/h	56
Fuel tank capacity	L	950

Lubrication System		
Oil capacity	L	50
Oil consumption	g/kwh	0.85
Oil pressure	kPa	345-483
(continuous operation)		

Cooling System		
Coolant capacity	L	26.5
Thermostat operation range	$^{\circ}\mathbb{C}$	82-93
Max water temperature	$^{\circ}$ C	104

Alternator		
Model	LONGKAI	LK544E
	STAMFORD	HCI544E-S5L1D-E4/S5L1S-E4
Phase		3
Voltage	V	400/230
Wiring Type	3 Ph	ase 4 wire, Y type
Bearing		1
Power factor		8.0
Frequency	Hz	50
Prime power	KW	488
Exciter Type	Brushle	ess, self-excitation
Voltage regulation	%	±0.5
Protection Grade		IP 23
Insulation grade		H/H
Altitude	m	≤1000

LG460C

Controller-DEEPSEA

Model DSE6120MK3

Protective functions:

- Low oil pressure
- High water temperature
- High/low voltage
- High Engine Temperature and Overspeed.
- Voltage regulator frequency regulator
- Emergency stop
- Start failure



Control Module Options






- ■Auto generator control module
- ■Control module with" Three Remote Control" functions
- ATS auto load transfer screen
- Synchronising control modules
- ■Power output cabinet




Standard Features

Engine(CCEC Cummins)
Radiator 50°C max,fans are driven by bel
24V charge alternator
Alternator: single bearing alternator IP23,
insulation class H/H
Standard auto control system
One set of air filter, fuel filter, oil filter
Main line circuit breaker/MCCB
Base fuel tank
Two 24V batteries, rac and cable
Exhaust system(Ripple flex exhaust pipe,
exhaust siphon, flange, muffler
User manual •

Unit Dimensions(Basic unit)

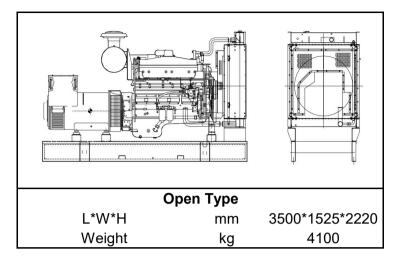

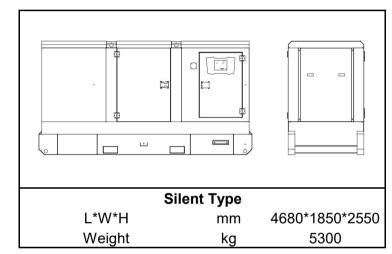

Options

Options		
Battery charge		\circ
Engine heater		\bigcirc
Alternator heater		\bigcirc
PMG		\bigcirc
Water oil separator		\bigcirc
Daily fuel tank		\bigcirc
Remote control panel		\bigcirc
Automatic transfer switch/ATS		\bigcirc
Switch box		\bigcirc
Standard: ●	Options:0	

Warranty*

Cummins Engine

12 months from date of purchase and 1000 hours.

Generator

12 months from date of purchase or 1000 hours (whichever occurs first).



More information, pls refer to our web-site: www.longkaipower.com

Manufacturer reserves the right to make changes in model, technical specification, color, equipment and accessories without notice.